




Interface

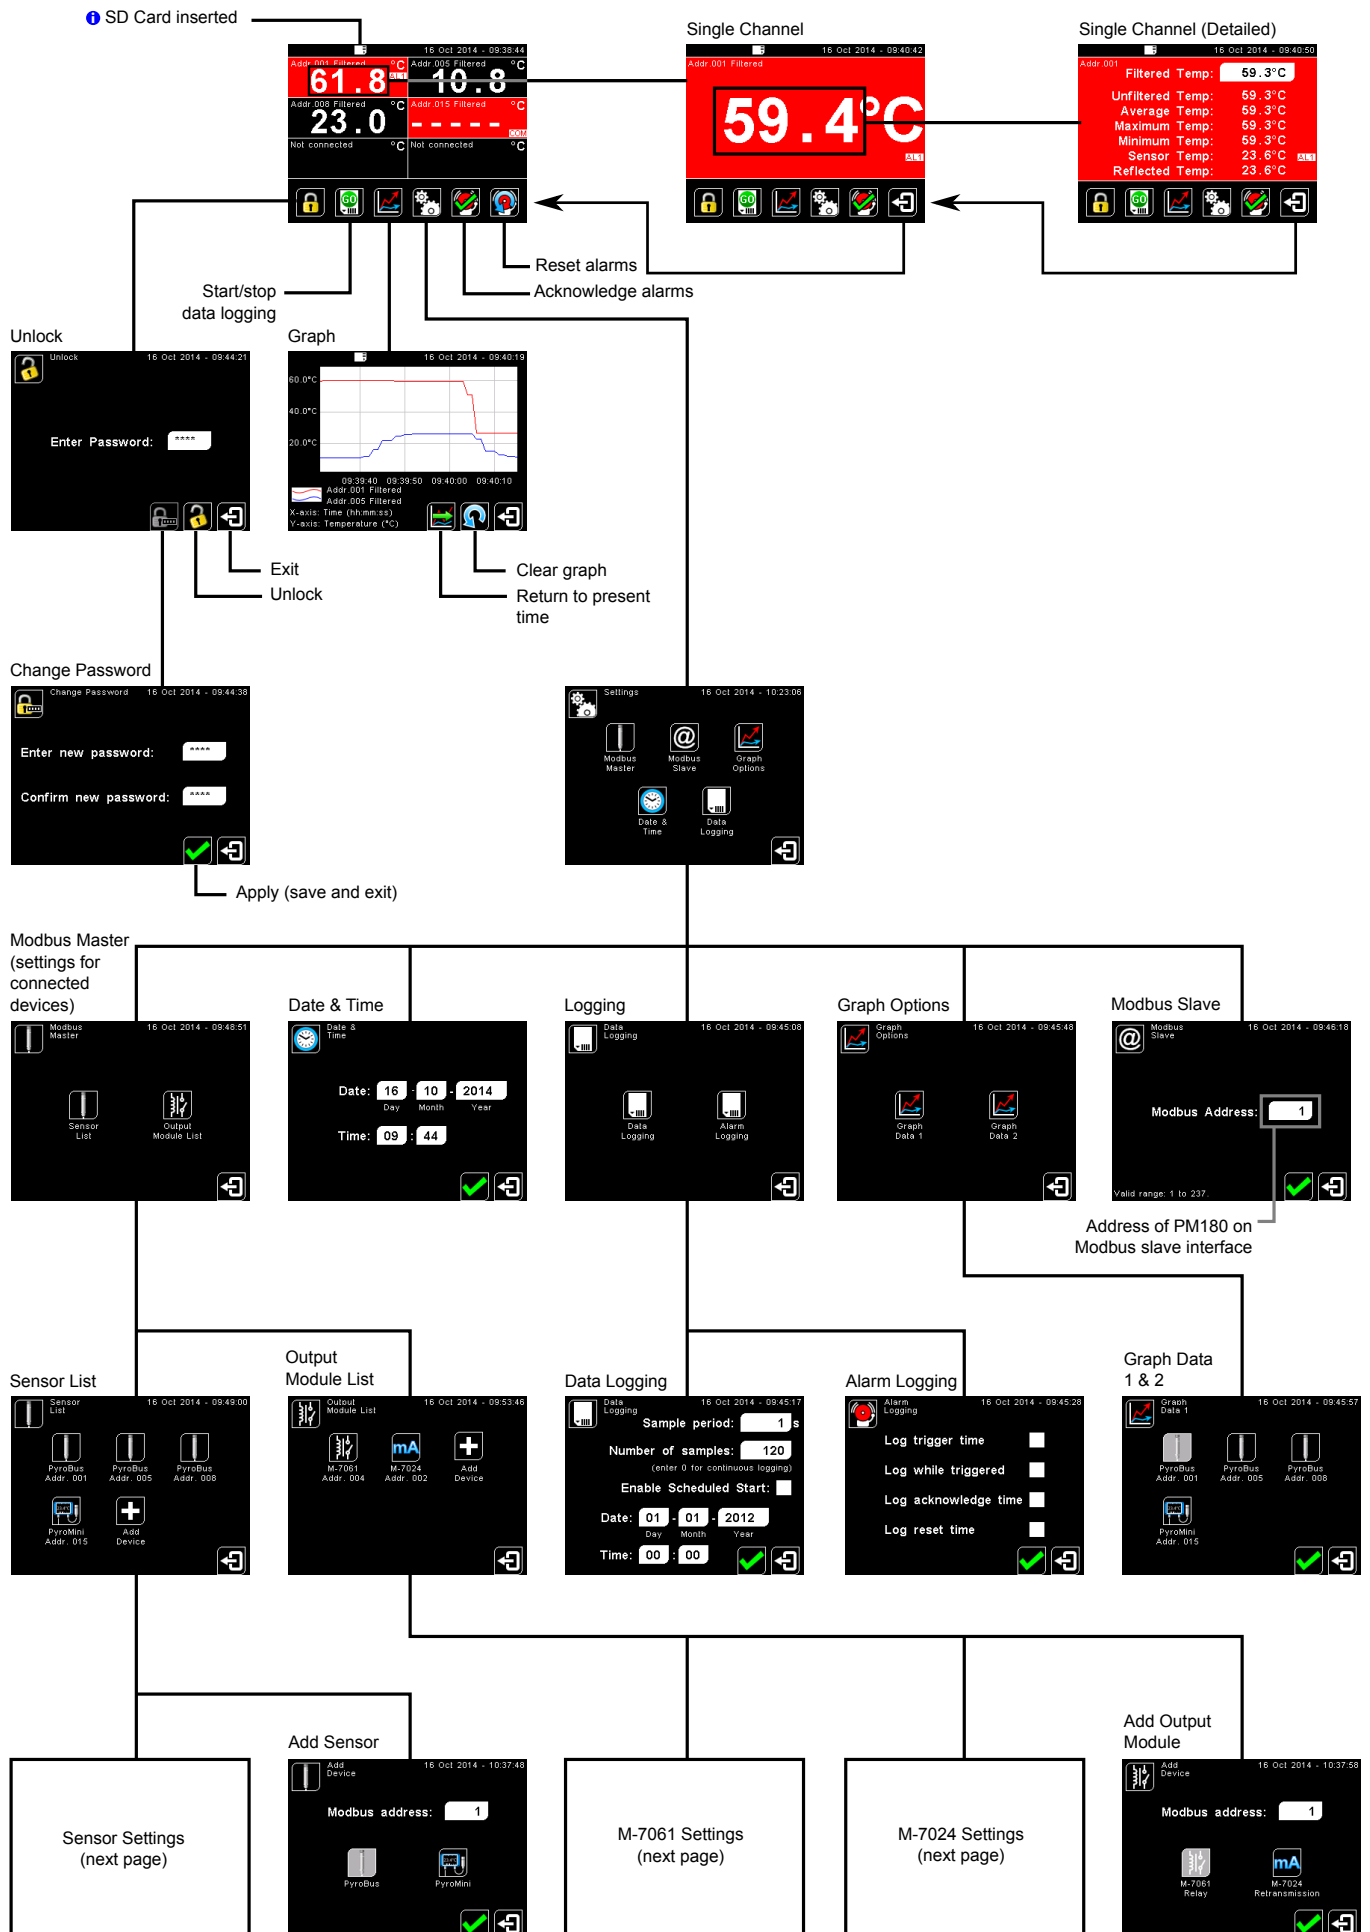


Sensor Settings




Processing




Display Options




Modbus Address




Alarms



Emissivity & Compensation



Alarm 1 & 2



M-7061 Relay Output Module Settings




Modbus Address




Output Settings




Output Status




Output Reference



Select Relay Event




M-7024 Analogue Output Module Settings




Modbus Address




Output Status



Output Settings




Output Type




Output 0-3



Output Range



Output Reference



Select Output Temperature

